


Australian Wool Testing Authority Ltd - trading as AWTA Product Testing A.B.N 43 006 014 106 1st Floor, 191 Racecourse Road, Flemington, Victoria 3031 P.O Box 240, North Melbourne, Victoria 3051 Phone (03) 9371 2400

TEST REPORT

Client : The Andrews 62 River Stre South Yarra	et		Test Numb Issue Date Print Date	-	20-00270 27/07/202 28/07/202	20	
Sample Description	Clients Ref : "Bolon felt back tile" Vinyl tile End Use : Flooring Nominal Composition : PVC/Plas Nominal Mass per Unit Area/Density Nominal Thickness : Approx: 5	sticizer/Calcium	carbonate filler/Fib :: 4.1kg/m2	reglass	s/ polyester f	elt	
ISO 9239.1-2003	Reaction to Fire Tests for Floorings. Determination of the Burning Behaviour using a						
	-	5. Determinati			-		
	Radiant Heat Source		_		-		
	-	s. Determinati	28/05/2020 27/07/2020				
	Radiant Heat Source Date of Sample Arrival Date Tested		28/05/2020 27/07/2020		-		
	Radiant Heat Source Date of Sample Arrival Date Tested CHF Value	1 10.2	28/05/2020 27/07/2020 2	3	Mean	kW/m²	
	Radiant Heat Source Date of Sample Arrival Date Tested	1	28/05/2020 27/07/2020 2	3	Mean	kW/m² kW/m²	
	Radiant Heat Source Date of Sample Arrival Date Tested CHF Value Length	1 10.2	28/05/2020 27/07/2020 2 10.2	3	Mean		
	Radiant Heat Source Date of Sample Arrival Date Tested CHF Value Length Width	1 10.2 10.2	28/05/2020 27/07/2020 2 10.2 9.9 2	3 10.1 -	Mean 10.2		
	Radiant Heat SourceDate of Sample ArrivalDate TestedCHF ValueLengthWidthSmoke Value	1 10.2 10.2 1	28/05/2020 27/07/2020 2 10.2 9.9 2	3 10.1 - 3	Mean 10.2 - Mean	kW/m²	

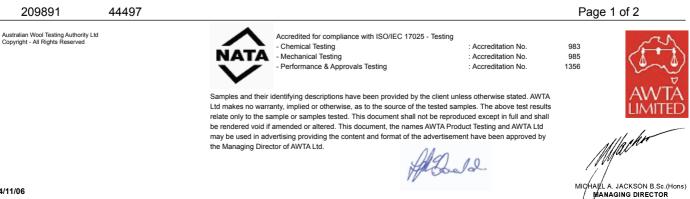

(C)



Australian Wool Testing Authority Ltd - trading as AWTA Product Testing A.B.N 43 006 014 106 1st Floor, 191 Racecourse Road, Flemington, Victoria 3031 P.O Box 240, North Melbourne, Victoria 3051 Phone (03) 9371 2400

TEST REPORT

Client :	The Andrews Group
	62 River Street
	South Yarra VIC 3141

Test Number	:	20-002700
Issue Date	:	27/07/2020
Print Date	:	28/07/2020

The test results relate to the behaviour of the test specimens of a product under the particular conditions of the test, they are not intended to be sole criterion for assessing the potential fire hazard of the product in use.

Sample was conditioned in accordance with BSEN 13238:2010 at a temperature of 23±2°C and relative humidity of 50±5% for a minimum of 48 hours prior to testing.

Each specimen was adhered to a substrate of 6mm thick fibre reinforced cement board using Roberts 656 adhesive and clamped prior to testing.

Results in accordance with section 8.4 have not been included in the report. They are available upon request.

HF30 not reported as flame out time occurred before 30 minutes.

209891

44497

© Australian Wool Testing Authority Ltd Copyright - All Rights Reserved



the Managing Director of AWTA Ltd

Accredited for compliance with ISO/IEC 17025 - Testing - Chemical Testing - Mechanical Testing - Performance & Approvals Testing

Samples and their identifying descriptions have been provided by the client unless otherwise stated. AWTA Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results relate only to the sample or samples tested. This document shall not be reproduced except in full and shall be rendered void if amended or altered. This document, the names AWTA Product Testing and AWTA Ltd may be used in advertising providing the content and format of the advertisement have been approved by

: Accreditation No. : Accreditation No. : Accreditation No.

983 985

1356

Page 2 of 2



APPROVED SIGNATORY

12

0204/11/06